



Coldwater Board of Public Utilities

Solar Net Billing Generator Interconnection Program Description

April 2021

Introduction

This document outlines the process, requirements, and agreements to install or modify Solar Generation Inverter Type Projects with a total nameplate capacity of less than 150 kW AC to operate in parallel with the Coldwater Board of Public Utilities electric system.

Net Billing Approval Process

The Owner-Operator must first fill out a Solar Generator Interconnection Application (Appendix A) and pay a one-time \$100 application fee. Along with the application the customer must furnish the required Interconnection Application Data (Appendix B). Once the application is approved, the Owner-Operator will be required to enter into a Solar Net Billing Agreement before operation in parallel with the electric system shall be granted.

Application Submittal

The Owner-Operator shall submit a completed Application, the necessary Application Data, and the application fee to the CBPU. Prior to submitting the Application, the Owner-Operator shall be familiar with CBPU Solar Net Billing Program, including but not limited to the Solar Net Billing Agreement.

Major Component Design Requirements

The data requested in Appendix B, for all major equipment and relaying proposed by the Owner-Operator, must be submitted as part of the initial application for review and approval by the CBPU. CBPU may request additional data to be submitted as necessary during the study phase to clarify the interconnection, equipment and protection system, and operation of the Distributed Energy Resource (DER).

Certification of Applicant's Design

Application must be signed by an engineer certifying that the distributed energy resource design fully complies with all state or local codes and/or requirements, industry standards not limited to NESC, NEC, and the IEEE, and all regulatory requirements set by MISO, NERC, and FERC.

Data

The data that CBPU requires in order to evaluate the proposed interconnection will be provided by the Owner-Operator on a "fill in the blank" checklist found in Appendix B. A site plan, one-line diagrams, and interconnection protection system details of the Distributed Energy Resource are required as part of the application data. The generator and inverter manufacturer data package should also be supplied.

Interconnection Study

Upon receipt of a fully completed Solar Generator Interconnection Application and a \$100 application fee, CBPU will perform an Interconnection Study to determine the impact of the Distributed Energy Resource on the CBPU's system, and the modifications required for safe and reliable interconnection of the Distributed Energy Resource to the system. Once the study is complete, CBPU shall in writing, inform the Owner-Operator, of the total aggregated size of the facility to be allowed on the system for the Distributed Energy Resource. ***Submittal of an Application does not guarantee that CBPU will approve the Solar Generator Interconnection Application.***

Solar Generator Interconnection Application Approval

Upon approval of the Solar Generator Interconnection Application by the CBPU, the Owner-Operator will be required to execute the Solar Net Billing Agreement.

Solar Net Billing Agreement

The Solar Net Billing Agreement outlines the terms and conditions of participation in the CBPU's Solar Net Billing Program. The Solar Net Billing Agreement is included in this document and can be found in Appendix C. It contains subjects such as construction of facilities, interconnection requirements, operating requirements, interconnection cost and billing, defaults and remedies, insurance, and liability. All CBPU costs, associated with making modifications to its distribution system, will be paid by the Owner-Operator.

Requirements for Solar Inverter Type Generation, Interconnection, and Operation

A sample copy of the requirements is included in this document and can be found in Appendix D. ***Once installed, the interconnection equipment must be reviewed and approved by CBPU prior to being connected to the electric system and before parallel operation is allowed.***

Ongoing Operations

The Owner-Operator and CBPU will exchange contact information and update this information from time to time. The Contact List to be completed can be found in Appendix E.

APPENDIX A
RENEWABLE GENERATOR INTERCONNECTION APPLICATION



SOLAR NET BILLING GENERATOR
INTERCONNECTION APPLICATION

COLDWATER BOARD OF PUBLIC UTILITIES CONTACT INFORMATION	
Coldwater Board of Public Utilities One Grand Street Coldwater, Michigan 49036 Attn: Engineering Department	
Customer and Account Information	
Customer Name (Last, First Middle Initial)	Customer Mailing Address
Customer Phone Number ()	Customer E-mail Address (Optional)
Electric Service Account #	Electric Service Meter #
Are You Applying for the Solar Net Billing Program <input type="checkbox"/> Yes <input type="checkbox"/> No	Are You Applying to Increase the Current Capacity of a Distributed Energy Resource <input type="checkbox"/> Yes <input type="checkbox"/> No
Solar Net Billing Site Information	
Physical Site Address (If Not Billing Address)	
Annual Site Requirements Without Generation in Kilowatt Hours kWh/Year:	Peak Annual Site Demand in Kilowatts (only for customers billed on Demand Rates) kW:
INSTALLATION INFORMATION	
Project Single Point of Contact (CBPU Customer or Developer)	
Name	Phone Number ()
E-mail Address	Requested in Service Date

Customer and Contractor Signatures

Attached \$100 Solar Net Billing Application Fee

Check # _____ Money Order # _____

Sign and Return Completed Application with Application Fee to Coldwater Board of Public Utilities


- 1. The undersigned Owner-Operator submits this Solar Generator Interconnection Application and appropriate filing fee to interconnect a new Distributed Energy Resource to the CBPU Electric System or to increase the capacity of an existing Distributed Energy Resource connected to the CBPU Electric System.
- 2. I, the undersigned and authorized representative of the Distributed Energy Resource, submit this Solar Generator Interconnection Application and required technical data for CBPU. I understand that CBPU must complete an Interconnection study to determine if Net Billing is available and the total aggregated size allowed for the facility. I also understand that I shall be required to furnish certain required technical data as requested by CBPU in support of this study.
- 3. The Solar Net Billing Agreement shall be executed within 60 calendar days upon approval of the Solar Generator Interconnection Application by the CBPU. Otherwise this Application will become null and void, and the Generator-Customer would need to reapply.

Customer Signature _____ Date _____

Contractor Signature (if applicable) _____ Date _____

SAMPLE SITE PLAN – PROVIDED FOR REFERENCE ONLY

SITE PLAN
Applicant
Address
City/Town
Signature

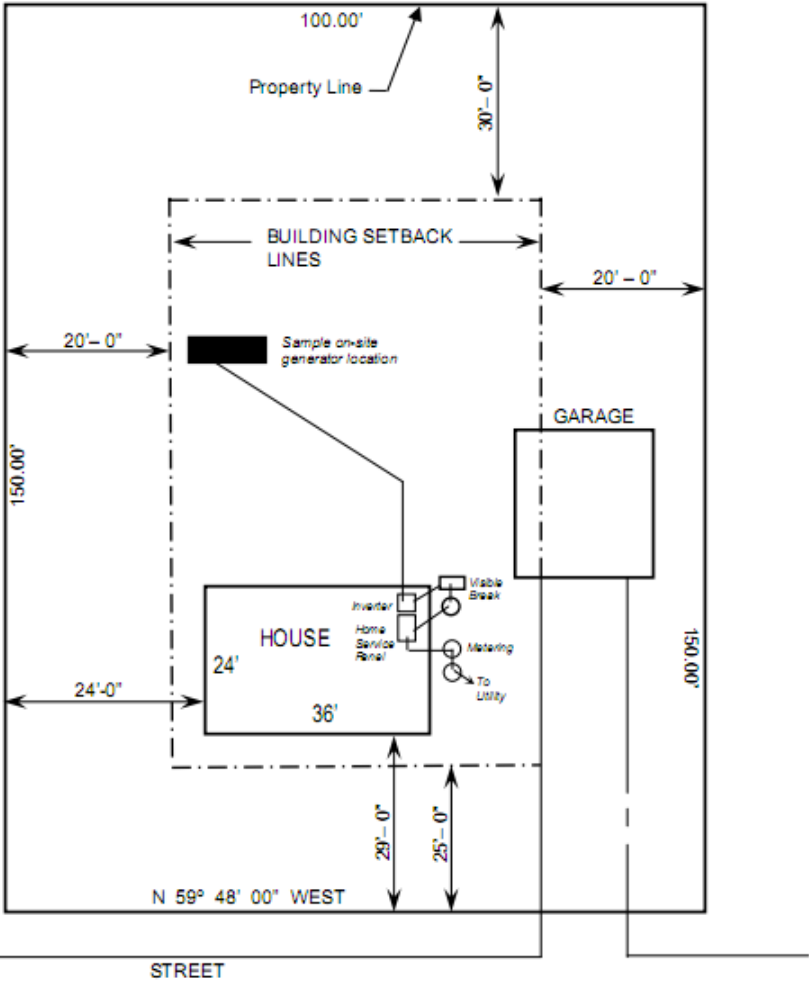

APPENDIX B
INTERCONNECTION APPLICATION DATA



**SOLAR NET BILLING GENERATOR
INTERCONNECTION APPLICATION DATA**

Instructions: Attach data sheets as required. Fill in or indicate in the table below, if appropriate, the page number of the attached data on which the requested information is provided. Provide one table and data for each unique generator.

Interconnection Application Data	
NAME	ADDRESS
GENERATOR TYPE	GENERATOR NAMEPLATE VOLTAGE
GENERATOR NAMEPLATE WATTS	GENERATOR NAMEPLATE POWER FACTOR
SHORT CIRCUIT CURRENT CONTRIBUTION AT POINT OF COMMON COUPLING	INVERTER TYPE
INVERTER MODEL NUMBER	WRITTEN COMMISSIONING TEST PROCEDURE ATTACHED? YES _____ NO _____
NATIONAL RECONIZED TESTING LABORATORY CERTIFICATION ATTACHED? YES _____ NO _____	SITE PLAN ATTACHED? YES _____ NO _____
ONE LINE DIAGRAM ATTACHED? YES _____ NO _____	OTHER DATA ATTACHED? YES _____ NO _____

APPENDIX C
COLDWATER BOARD OF PUBLIC UTILITIES
RENEWABLE NET BILLING AGREEMENT

COLDWATER BOARD OF PUBLIC UTILITIES

SOLAR NET BILLING AGREEMENT

FOR OWNER-OPERATOR SYSTEMS

THIS SOLAR NET BILLING AGREEMENT (the “Agreement”), is made as of this _____ day of _____, _____, by and between Coldwater Board of Public Utilities, (“CBPU”) and _____, (“Owner-Operator”) for service at _____ . CBPU and the Customer-Generator are sometimes referred to herein individually as “Party” and collectively as the “Parties.”

RECITALS

- A. CBPU is a municipal utility engaged in the generation, sale and distribution of electric energy, pursuant to the CBPU’s Policies and procedures, and availability of Rates.
- B. Owner-Operator receives electrical service from CBPU at rates contained in the CBPU’s rate tariff sheets and desires to obtain service from CBPU under its available Rates and Solar Net Billing Policy.
- C. Owner-Operator will be installing and desires to operate in-parallel with the CBPU’s electric system, from and after the date of this Agreement, certain electrical equipment at the above location, consisting of:
_____ and related facilities and equipment having an aggregate generation of _____ kilowatts using only a renewable fuel or energy source (“Distributed Energy Resource”), for the purpose of offsetting up to 80% of the Owner-Operator’s electric service requirements.
- D. It is anticipated that the Distributed Energy Resource may, from time-to-time, generate less than all of the Owner-Operator’s electrical requirements at the Distributed Energy Resource location. The Distributed Energy Resource may, from time-to-time, generate energy in excess of the Owner-Operator’s electrical requirements at the Distributed Energy Resource location.
- E. The Distributed Energy Resource and the CBPU’s electric system will be interconnected at one meter location indicated in the Solar Net Billing Policy and Solar Net Billing Agreement.
- F. Acceptable forms of generation shall be limited to renewable inverter type generation using a renewable energy source of solar and not fossil fuels such as oil, gasoline, or natural gas.
- G. All Solar Net Billing projects shall be located on property owned and occupied by the applicant.

AGREEMENT

NOW, THEREFORE, for and in consideration of the mutual benefits to be derived therefrom, CBPU and Owner-Operator agree as follows:

1 Service Under Available Rates

Owner-Operator has or will be receiving service from CBPU pursuant to the CBPU's Policies and procedures, and available Rates, and will continue to receive such service pursuant to their terms and conditions as may be amended by the CBPU, and pursuant to the terms and conditions of this Agreement.

2 Parallel Operation

Owner-Operator shall, pursuant and subject to the CBPU's Rates, Solar Net Billing Policy, and this Agreement between Owner-Operator and CBPU, deliver into the CBPU's electric system all energy generated by the Distributed Energy Resource in excess of Owner-Operator's electrical requirements.

The Owner-Operator shall secure and maintain all necessary certificates and permits from municipal or other public authorities and comply with all national, state, and municipal laws, ordinances, and regulations as may be required.

CBPU shall install an additional meter to register the flow of energy of the DER. An additional monthly meter service fee per Rates, Rules and Regulations of CBPU will be charged to the Owner-Operator. CBPU shall own, operate and maintain all required billing metering equipment.

The Owner-Operator assumes all liability and agrees that CBPU has no liability for damage to the Distributed Energy Resource or other Customer or third party owned property on its side of the point of connection.

3 Aggregate Size Limitation on Distributed Energy Resource

The purpose of this Agreement is to set the provisions by which Customer-Generator may install renewable generating equipment intended primarily to offset all or a portion of the Owner-Operator load at a given location. The Owner-Operator is limited by this Agreement to installing generating equipment not to exceed 80% of the annual calculated or metered electrical need of the Owner-Operator. The Distributed Energy Resource may not exceed a total nameplate capacity of 20 kW DC.

Upon receiving an application from the Owner-Operator, CBPU will determine the maximum allowable total nameplate capacity of the Distributed Energy Resource. The Owner-Operator is required to pay a non-refundable \$100 application fee.

The Owner-Operator requirements for electricity shall be determined by one of the following methods:

- 3.1 The Owner-Operator annual energy usage, measured in kWh, during the previous 12-month period.
- 3.2 When metered demand is available, the maximum integrated hourly demand measured in kW during the previous 12-month period.
- 3.3 In instances where the complete and correct data is not available or where the Owner-Operator makes changes on-site that will affect total usage, the Owner-Operator and CBPU shall mutually agree on a method to determine the customer's electric requirements for electricity.

An Owner-Operator shall be considered to be in violation of this Agreement and the Net Billing Policy if the Owner-Operator installs a Distributed Energy Resource with a nameplate capacity greater than that which was approved by the CBPU. All agreements shall immediately be void and the project must be suspended or the customer may have this Agreement terminated until the violation is corrected and approved by the CBPU.

Any renewable credits shall be owned by the Owner-Operator.

4 Delivery of Excess Energy Generated by the Generating Facility

- 4.1 Owner-Operator shall deliver into the CBPU's electric system at the Point of Common Connection all excess electric energy generated by the Generating Facility.

The "Point of Common Connection" is the location where the CBPU's electric system is interconnected with the Generating Facility. Such excess electric energy shall be delivered in the form of _____ phase, sixty hertz, and alternating current at _____ volts. In no event shall Owner-Operator deliver into the CBPU's electric system electric energy at more than five percent (5%) above or five percent (5%) below such voltage.

- 4.2 Net Energy Billing Terms and Conditions
 - (a) CBPU shall measure the net electricity produced or consumed by the Owner-Operator during each billing period, in accordance with normal metering practices
 - (b) If the electricity supplied by CBPU exceeds the electricity generated by the Owner-Operator during the billing period, or any portion thereof, then the Owner-Operator shall be billed at the rate under which the Owner-Operator takes service for the net electricity supplied by the CBPU. In addition, the Customer-Generator shall be billed the appropriate customer charge paid by other customers in the same electrical tariff rate class for each meter and any other charges, such as demand and reactive power charges and other charges applicable to energy use and applicable adjusting rates.

- (c) If the electricity generated by the Owner-Operator during the billing period, or any portion thereof, exceeds the electricity supplied by the CBPU, then the Owner-Operator shall be:
 - i. billed for the appropriate customer charge as other customers in the same electrical tariff rate class for each meter and any other charges, such as demand and reactive power charges and any applicable adjusting rates; and
 - ii. be credited for the net excess kilowatt-hours generated during the billing period. The kilowatt-hour credit will be used to offset future consumption with the consumption credit not to be carried forward more than 12 monthly billing cycles.
- (d) Owner-Operator shall pay any amount owing for electric service provided by CBPU in accordance with applicable Rates and Policies. Nothing in this Agreement shall limit the CBPU's rights under applicable Rate schedules and Policies.
- (e) Any unused energy (kWh) credits accumulated by the Customer-Generator during a continuous twelve month period shall be granted to CBPU without any compensation to the Customer-Generator on the first billing cycle in January of each year.

5 Interruption

- 5.1 At any time, and from time-to-time, CBPU may disconnect its electric system from the Generating Facility or may interrupt or reduce the flow of energy to or from the Generating Facility if, in the CBPU's sole determination, the Generating Facility is not in compliance with this Agreement.
- 5.2 At any time, and from time-to-time, CBPU may disconnect its electric system from the Generating Facility or may interrupt or reduce the flow of energy to or from the Generating Facility if, in the CBPU's sole determination, failure to do so
 - (a) would interfere with, endanger or adversely affect the CBPU's electric system or operations,
 - (b) would endanger any person or the property of the CBPU, the Owner-Operator, or any third party, or
 - (c) would be unsafe or contrary to prudent electrical practices.

For the purposes of this Agreement "prudent electrical practices" means (a) those practices, methods and acts which when engaged in are commonly used in prudent CBPU engineering and operations to operate electric equipment lawfully and with safety, reliability, efficiency and expedition; or (b) if no such practices, methods and acts exist, then those practices, methods and acts which, in the exercise of reasonable

Judgment considering the facts with applicable law, safety, reliability, efficiency and expedition.

Prudent electrical practices are not limited to the optimum practice, method or act, but rather is a spectrum of possible practices, methods or acts.

- 5.3 CBPU shall not be obligated to continue the interconnection to the Generating Facility if any one or more of the following conditions exist, including but not limited to: (a) those conditions listed in Attachment A – Requirements For Solar Inverter Type Generation, Interconnection and Operation, (b) the electrical characteristics of the Generating Facility are not compatible with the electrical characteristics of CBPU's distribution system, (c) the Owner-Operator is deficient in following either the voltage schedule or reactive power schedule established by CBPU, (d) an emergency condition exists on CBPU's distribution system, (e) Owner-Operator's protective relay equipment fails, resulting in a lack of the level of protection required by prudent CBPU practice, (f) the Owner-Operator's Generating Facility is determined to be disrupting CBPU customers or (g) CBPU requires disconnecting the Generating Facility in order to construct, install, maintain, repair, replace, remove, investigate, inspect or test any part of CBPU's Interconnection Facilities or any other CBPU equipment associated with the interconnection (also if a required component (example: phone line) or required modification to allow interconnection fails or becomes incapacitated and is not repaired in a timely manner). CBPU shall electrically connect or reconnect its distribution system to the Generating Facility when, in CBPU's sole opinion, the conditions named above cease to exist.
- 5.4 Unless caused by the sole negligence or intentional wrongdoing of the CBPU, CBPU shall have no liability (whether arising in contract, tort, strict liability, warranty or otherwise) for any loss or damage whatsoever arising out of any action taken by CBPU pursuant to this Section and Owner-Operator hereby releases CBPU from such liability. Unless caused by the sole negligence or intentional wrongdoing of the CBPU, Owner-Operator shall not be entitled to any monetary compensation, financial reimbursement, or claim (whether arising in contract, tort, strict liability, warranty or otherwise) for any interruption of service, loss of generation, or any other loss or damage whatsoever arising out of any action taken by CBPU pursuant to this Section and Owner-Operator hereby releases CBPU from such compensation, reimbursement, or claim.

6 Term and Termination

- 6.1 This Agreement is effective upon execution the day and year first above written. Continued service under this Agreement is contingent upon the availability under the CBPU's Net Billing Policy.
- 6.2 Either party may disconnect the Generating Facility at any time upon thirty (30) days written notice to the other party and this Agreement shall terminate upon permanent physical removal of facilities necessary to interconnect the Generating Facility with the CBPU's electric system; provided that all obligations incurred before the termination of this Agreement shall survive such termination and continue in full force and effect until fully satisfied.
- 6.3 Under no circumstances shall the output from a Generating Facility be sold to a third party, credited to a third party, or any other CBPU customer.
- 6.4 This Agreement shall immediately terminate if the Owner-Operator has not started construction by _____, _____, 2022 or Generating Facility has not been inspected, tested, and approved by CBPU by _____, _____, 2022. In either instance CBPU shall notify Owner-Operator in writing of the automatic termination. CBPU shall not be liable for any expenses incurred by Owner-Operator as a result of the termination.

7 Governmental Authority

Owner-Operator shall obtain all governmental authorizations, licenses and permits needed for the construction and operation of the Generating Facility.

The Owner-Operator shall secure and maintain all necessary certificates and permits from municipal or other public authorities and comply with all national, state, and municipal laws, ordinances, and regulations as may be required.

8 Requirements for Generation, Interconnection and Operation

Owner-Operator shall comply with the Requirements for Solar Inverter Type Generation, Interconnection and Operation (herein referred to as Requirements) as shown on Attachment A (Found in Appendix D) attached hereto and incorporated here by reference.

9 Information

Owner-Operator represents that all information in its application or submitted in connection with that application is true. Owner-Operator shall promptly furnish CBPU with copies of such plans, specifications, records, and other information relating to the Generating Facility or the ownership, operation, use, or maintenance of the Generating Facility, as may be reasonably requested by CBPU from time-to-time. All such information, together with any and all other

documents and information furnished to CBPU under this Agreement shall be given to CBPU on a non-confidential basis.

10 Notices and Other Communications

All notices, requests, demands and other communications required or permitted to be given under this Agreement shall be given in writing (i) by personal delivery, (ii) by recognized overnight air courier service, (iii) by United States postal service, postage prepaid, registered or certified mail, return receipt requested. All notices to either Party shall be made to the address set forth below. Any notice shall be deemed to have been given on the date delivered, if delivered personally, by overnight air courier service, or, if mailed, shall be deemed to have been given on the date shown on the return receipt as the date of delivery.

Addresses for Notification.

CBPU:

Coldwater Board of Public
Utilities
Attn: Engineering Department
One Grand Street
Coldwater, MI 49036

Tel. (517) 279-9531
FAX (517) 279-0805

Owner-Operator:

Attn: _____
Tel. () _____
FAX () _____

11 Dispute Resolution

If any party has a dispute with another regarding the meaning, operation, or enforcement of any provision of this Agreement, the disputing parties agree to meet and confer to negotiate a resolution of the dispute. If they are unable to resolve the dispute themselves and before formally instituting any other dispute mechanism, they shall utilize the services of a mutually acceptable neutral mediator, who meets the qualifications of MCR 2.411, to bring them together in at least one mediation session. All meetings, hearings and actions to resolve the dispute shall be in Branch County.

12 CBPU Policies and Rates

This Agreement is subject to all CBPU Policies, including the Net Billing Policy, the availability of Rates, and any other general rules and provisions as set forth by CBPU that may apply. Such practices, policies, procedures, programs, or rates may be revised from time-to-time upon approval of the CBPU's Board. Any conflict between this Agreement and any provisions of the

CBPU's approved rate schedules shall be resolved in favor of such rate schedule provisions. Terms defined in the CBPU's rates, practices policies or procedures shall have the same meaning when used in this Agreement unless the usage clearly indicates otherwise.

13 Assignment

This Agreement and all of the terms and provisions of this Agreement shall be binding upon and inure to the benefit of the respective successors and assigns of the Parties; provided, that Owner-Operator shall not assign all or any part of this Agreement (or assign any of its rights under this Agreement or delegate performance of any of its obligations under this Agreement) without prior written consent of the CBPU.

14 Subcontractors

Either Party may hire a subcontractor to perform its obligations under this Agreement. However, each Party shall require its subcontractors to abide by the terms of this Agreement. Each Party shall remain primarily liable to the other Party for the performance of such subcontractor. Hiring a subcontractor does not release either Party from any of its obligations.

15 Independent Contractor

Owner-Operator shall be and act as an independent contractor (and not as an employee, partner, agent, or representative of the CBPU) in the performance of this Agreement.

16 Governing Law

This Agreement shall in all respects be interpreted, construed and enforced in accordance with the laws of the State of Michigan (without regard to any conflict of law rules).

17 Survival of Terms

All obligations of the Parties arising pursuant to this Agreement which may reasonably be construed as surviving the completion, termination, or cancellation, shall survive the completion, termination, or cancellation of this Agreement and shall be and remain fully enforceable in accordance with the terms and conditions of this Agreement.

18 No Partnership

This Agreement shall not be interpreted or construed to create an association, joint venture or partnership between the Parties or to impose any partnership obligations or liability upon either of the Parties.

19 No Third Party Beneficiaries

This Contract is intended for the benefit of the parties hereto and does not grant any rights to any third parties unless otherwise specifically stated herein.

20 Entire Agreement

Except as otherwise provided herein, this Agreement, including all attachments and exhibits hereto, and including all documents referenced herein, sets forth the entire agreement between the Parties. This Agreement may not be modified or amended except by written amendment, signed by both Parties hereto.

21 Force Majeure

Neither Party shall be considered to be in Default with respect to any obligation hereunder other than the obligation to pay money when due, if prevented from fulfilling such obligation by Force Majeure. A Party unable to fulfill any obligation hereunder (other than an obligation to pay money when due) by reason of Force Majeure shall give notice and the full particulars of such Force Majeure to the other Party in writing or by telephone as soon as reasonably possible after the occurrence of the cause relied upon. Telephone notices given pursuant to this article shall be confirmed in writing as soon as reasonably possible and shall specifically state full particulars of the Force Majeure, the time and date when the Force Majeure occurred and when the Force Majeure is reasonably expected to cease. The Party affected shall exercise due diligence to remove such disability with reasonable dispatch, but shall not be required to accede or agree to any provision not satisfactory to it in order to settle and terminate a strike or other labor disturbance.

22 Indemnity

The Owner-Operator at all times assume all liability for its own acts and property, and shall indemnify and save CBPU harmless from, any and all damages, losses, claims, demands, suits, recoveries, costs, legal fees, and expenses for injury to or death of any person or persons whomsoever, or for any loss, destruction of or damage to any property of third persons, firms, corporations or other entities, including environmental harm or damage arising out of or resulting from, either directly or indirectly, the acts of the Customer- Generator or the Generating Facility. The provisions of this Section shall survive termination or expiration of this Agreement.

23 Limitation on Liability

NEITHER PARTY SHALL IN ANY EVENT BE LIABLE TO THE OTHER FOR ANY INCIDENTAL OR CONSEQUENTIAL DAMAGES SUCH AS, BUT NOT LIMITED TO, LOST PROFITS, REVENUE OR GOOD WILL, INTEREST, LOSS BY REASON OF SHUTDOWN OR NON-OPERATION OF EQUIPMENT OR MACHINERY, INCREASED EXPENSE OF OPERATION OF EQUIPMENT OR MACHINERY, COST OF PURCHASED OR REPLACEMENT POWER OR SERVICES OR CLAIMS BY CUSTOMERS, WHETHER SUCH LOSS IS BASED ON CONTRACT, WARRANTY,

NEGLIGENCE, STRICT LIABILITY OR OTHERWISE, EVEN IF IT HAS BEEN ADVISED OF THE POSSIBILITY OF SUCH DAMAGES.

24 Effective Date

The Effective Date of this Agreement shall be the date of execution and shall continue in effect until this Agreement is terminated as provided herein.

25 Retirement

Upon termination of this Agreement or at such time after any of the Interconnection Facilities described herein are no longer required, then the Interconnection Facilities shall be retired. Retirement of said Interconnection Facilities may include without limitation (i) dismantling, demolition, and removal of equipment, facilities, and structures, (ii) security, (iii) maintenance and (iv) disposing of debris. The cost of such removal shall be borne by the Party owning such Interconnection Facilities.

26 Breach and Default

A breach of this Agreement (“Breach”) shall occur upon the failure of a Party to perform or observe any material term or condition of this Agreement. A default of this Agreement (“Default”) shall occur upon the failure of a Party in Breach of this Agreement to cure such Breach. Examples of Default include, but are not limited to:

- a. Failure to pay money when due;
- b. Failure to comply with any material term or condition of this Agreement, including but not limited to any material Breach of a representation, warranty or covenant made in this Agreement;
- c. A Party: (a) becomes insolvent; (b) files a voluntary petition in bankruptcy under any provision of any federal or state bankruptcy law or shall consent to the filing of any bankruptcy or reorganization petition against it under any similar law; (c) makes a general assignment for the benefit of its creditors or (d) consents to the appointment of a receiver, trustee, or liquidator;
- d. Assignment of this Agreement in a manner inconsistent with the terms of this Agreement;
- e. Failure of either Party to provide such access rights, or a Party’s attempt to revoke or terminate such access rights, as provided under this Agreement;
- f. Failure of either Party to provide information or data to the other Party as required under this Agreement provided the Party entitled to the information or data under this Agreement requires such information or data to satisfy its obligations under this Agreement.

In the event of a Breach or Default by either Party, the Parties shall continue to operate and maintain, as applicable, its Interconnection Facilities, including but not limited to: protection and metering equipment, transformers, communication equipment, building facilities, software, documentation, structural components and other facilities and appurtenances that are reasonably necessary for CBPU

to operate and maintain its distribution system and for the Owner-Operator to operate and maintain its Generating Facility in a safe and reliable manner. Upon a Default, the non-defaulting Party shall give written notice of such Default to the defaulting Party. The defaulting Party then has 30 days to cure the Default. If a Default is not cured within the period provided for herein or as agreed to by the Parties, the non-defaulting Party shall have the right to terminate this Agreement by written notice and shall be relieved of any further obligations hereunder. Further, in the event of such termination, the non-defaulting Party shall be entitled to recover from the defaulting Party all amounts due hereunder, all other damages and remedies to which it is entitled at law or in equity and costs including actual attorney fees. The provisions of this Section shall survive termination of this Agreement.

29 Severability

If any provision or portion of this Agreement shall for any reason be held or adjudged to be invalid or illegal or unenforceable by any court of competent jurisdiction or other governmental authority, (1) such portion or provision shall be deemed separate and independent, (2) the Parties shall negotiate in good faith to restore insofar as practicable the benefits to each Party that were affected by such ruling, and (3) the remainder of this Agreement shall remain in full force and effect.

30 Electronic Documents

After the Agreement has been duly signed, delivered and received, by either party to the other party by means of telecopy (fax) transmission or attached to an email (or similar electronic transmission) in an unalterable image format, the Agreement shall be considered as validly delivered as the physical delivery of the signed Agreement in paper form. In addition, it is further understood that this Agreement may be imaged and stored electronically and introduced as evidence in any proceeding as if an original business record; and neither party will object to the admissibility of such an image as evidence in any proceeding on account of having been stored electronically.

Utility
Coldwater Board of Public Utilities

Owner-Operator

By: _____
Andrew Cameron

By _____

Its: Electrical Engineer

Its _____

Date _____

Date _____

APPENDIX D
REQUIREMENTS FOR SOLAR INVERTER TYPE
GENERATION, INTERCONNECTION & OPERATION
(Attachment A to the Solar Net Billing Agreement)

ATTACHMENT A
REQUIREMENTS FOR SOLAR INVERTER TYPE
GENERATION, INTERCONNECTION & OPERATION

The following are further REQUIREMENTS FOR SOLAR INVERTER TYPE GENERATION, INTERCONNECTION & OPERATION (hereinafter Requirements):

- 1 Request for Service:** The Owner-Operator has requested to interconnect and operate in parallel a generation plant with aggregate generation as indicated in the Agreement to the CBPU's distribution system. In order to provide said interconnection, it may be necessary for CBPU to install certain Interconnection Facilities of which the general location and type of facilities are depicted in Exhibit 1 - Interconnection Diagram. Exhibit 1 shall also define the design and physical construction of all the Interconnection Facilities of which the Customer/Generator shall solely bear the costs.
- 2 Site Preparation/Access:** At its own expense, the Owner-Operator shall make the proposed Generating Facility site available to CBPU. Said site shall be free from hazard and shall be adequate for the operation and construction of the Interconnection Facilities necessary to connect the proposed Generating Facility. CBPU, its agents and employees, shall have full right and authority of ingress and egress at all reasonable times on and across the premises of the Generating Facility for the purpose of installing, operating, maintaining, inspecting, replacing, repairing, and removing its Interconnection Facilities located on the premises. The right of ingress and egress, however, shall not unreasonably interfere with Owner-Operator's use of its premises.
- 3 Easements/Permits:** If necessary, prior to the installation of the Interconnection Facilities and anytime thereafter, CBPU will acquire required permits and necessary easements for its Interconnection Facilities. These easements / permits may include, but shall not be limited to, easements to clear trees, and necessary rights-of-way for installation and maintenance of its Interconnection Facilities. The Owner-Operator shall reimburse CBPU for its costs and expenses for acquiring such easements / permits.
- 4 Parallel Operation:** It is understood that the Generating Facility will normally remain connected to and be operated in parallel with the CBPU's distribution system. The Owner-Operator shall, at its expense, install and properly maintain protective equipment and devices and provide sufficiently trained personnel to protect its equipment and service, and the equipment and service of CBPU from damage, injury or interruptions during the Generating Facility's parallel operation with CBPU's distribution system, and, without limiting the indemnity provided herein, will assume any loss, liability or damage to the

Generating Facility caused by lack of or failure of such protection. Such protective equipment specifications and design shall be consistent with the CBPU's requirements. Prior to the Generating Facility operating in parallel with CBPU distribution system, the Customer- Generator shall provide satisfactory evidence to CBPU that it has met the requirements set forth in the CBPU's Net Billing Agreement, which includes, but is not limited to, approval from the local building code inspector and electrical inspector.

The Owner-Operator will be solely responsible for the required synchronizing equipment and for properly synchronizing the Generating Facility with CBPU electric system. CBPU shall not be responsible for any damages to the customer's equipment or facility as a result of the Generating Facility.

Voltage fluctuation at the PCC during synchronizing is limited by IEEE Std. 1547.1.

The Owner-Operator is responsible for all damages caused to the CBPU's system or to any other CBPU customer's property from the Generating Facility.

The following requirements apply directly to the actual operation of the Generating Facility with the CBPU:

- The Generating Facility may not commence parallel operation until approval has been given by the CBPU. The completed installation is subject to inspection by CBPU prior to approval. Preceding this inspection, all contractual agreements must be executed by the Owner-Operator.
- The Generating Facility must be designed to prevent the Generating Facility from energizing a de-energized CBPU line. The Generating Facility's circuit breaker or contactor must be blocked from closing in on a de-energized circuit.
- The Generating Facility shall discontinue parallel operation with a particular service and perform necessary isolation when requested by CBPU for any of the following reasons:
 1. When CBPU personnel or public safety may be jeopardized.
 2. During voltage or loading problems, system emergencies, or when abnormal sectionalizing or circuit configuration occurs on CBPU system.
 3. During scheduled shutdowns of the CBPU's equipment that are necessary to facilitate maintenance or repairs. Such scheduled shutdowns shall be coordinated with the Owner-Operator.
 4. In the event there is demonstrated electrical interference (i.e. Voltage Flicker, Harmonic Distortion, etc.) impacting the CBPU's customers, suspected to be caused by the Generating Facility, and such interference

exceeds then current industry standards, CBPU reserves the right, at the CBPU's initial expense, to install special test equipment as may be required to perform a disturbance analysis and monitor the operation and control of the Generating Facility to evaluate the quality of power produced by the Generating Facility. In the event that no standards exist, then the applicable tariffs and rules governing electric service shall apply. If the Generating Facility is proven to be the source of the interference, and that interference exceeds the CBPU's standards or the generally accepted industry standards, then it shall be the responsibility of the Customer/Generator to eliminate the interference problem and to reimburse CBPU for the costs of the disturbance monitoring installation, removal, and analysis, excluding the cost of the meters or other special test equipment, and any costs of damages.

5. When either the Generating Facility or its associated synchronizing and protective equipment is demonstrated by CBPU to be improperly maintained, so as to present a hazard to the CBPU's employees, system, or its customers.
6. Whenever the Generating Facility is operating isolated with other CBPU customers, for whatever reason.
7. Whenever a loss of communication channel alarm is received from a location where a communication channel has been installed for the protection of the CBPU's system.
8. Whenever CBPU notifies the Owner-Operator in writing of a claimed non-safety related violation as determined by CBPU and the Owner-Operator fails to remedy the claimed violation within 10 business days of notification, unless within that time the Customer- Generator and CBPU agree in writing to a different procedure.

If the Generating Facility has shown an unsatisfactory response to requests to separate the generation from CBPU system, CBPU reserves the right to disconnect the Generating Facility from parallel operation with CBPU electric system until all operational issues are satisfactorily resolved.

- 5 Installation Approval:** Prior to final approval for parallel operation, the CBPU's specified relay calibration settings shall be applied and a commissioning test must be performed on the generator relaying and control equipment that involves the protection of CBPU electric system. The commissioning test must be witnessed by the CBPU. The Owner-Operator must provide CBPU with a minimum 10 business days advance written notice of when the Generating Facility will be ready for inspection, testing, and approval. The Customer- Generator shall perform operational testing and inspection of the Generating Facility at least 5 days before interconnection. The Owner-Operator shall contact CBPU and arrange for a mutually agreeable time for performing said tests. CBPU may send qualified personnel to the Generating Facility site to

inspect the Generating Facility and observe the testing. Owner-Operator shall provide CBPU a written test report when such testing and inspection is completed and prior to interconnection, for CBPU review and approval. Inspection, testing and / or approval by CBPU or the omission of any inspection, testing and/or approval by CBPU pursuant to this Agreement shall not relieve the Customer-Generator of any obligations or responsibility assumed under this Agreement.

- 6 Isolation Device:** An isolation device is required for interconnection and should be placed at the Point of Common Coupling (PCC). It can be a circuit breaker, circuit switcher, pole top switch, load-break disconnect, etc., depending on the electrical system configuration. The following are required of the isolation device:
- Must be approved for use on CBPU system.
 - Must comply with current relevant ANSI, UL 1741 scope 1.1A, and IEEE Standards.
 - Must have load break capability.
 - Must be rated for the application.
 - If used as part of a protective relaying scheme, it must have adequate interrupting capability. CBPU will provide maximum short circuit currents and X/R ratios available at the PCC, upon request.
 - Must be lockable, operable and accessible by CBPU at all times (24 hours a day, 7 days a week).
 - CBPU will determine if the isolation device will be used as a protective tagging point. If the determination is so made, the device must have visible open break provisions for padlocking in the open position and it must be gang operated. If the device has automatic operation, the controls must be located remote from the device.
 - Must be located outside within five feet of the main service (as allowed by code).
 - Must be approved by UL.
- 7 Inverters:** All inverters used in the Generating Facility must comply with the IEEE standard 1547.1 and UL 1741 requirements for anti-islanding and disconnection from faults. All inverters to be installed shall have the UL 1741 listing.
- 8 Battery System:** Battery system is defined as DC batteries, inverter, and all other equipment that is used to store electricity. The Owner-Operator shall not be allowed to deliver power from the batteries to the grid. Separate inverters for the battery system must conform to the specifications listed in section 7. A single

inverter that runs the battery system and the panels is allowed. Any battery system must be present on the system one-line with its rated capacity. Any changes to the capacity of the battery system must be reported to the utility. The customer-generator is solely responsible for the maintenance and replacement of the battery system.

- 9 Periodic Maintenance and Testing Program:** CBPU reserves the right to test the relaying and control equipment that involves protection of the electric system whenever CBPU determines a reasonable need for such testing exists.

The Owner-Operator is solely responsible for conducting proper periodic maintenance on the generating equipment and its associated control, protective equipment, interrupting devices, and main isolation device.

Protective relay equipment shall be tested every two (2) years (unless an extension is agreed to by CBPU) to verify the calibration indicated on the latest relay setting document issued by CBPU. Tests shall be conducted or witnessed by CBPU at Owner-Operator's expense. The results of such tests shall be provided to CBPU in writing for review and approval. CBPU may, at any time and at the CBPU's expense, inspect and test the Generating Facility to verify that the required protective interconnection equipment is in service, properly maintained, and calibrated to provide the intended protection. If necessary, this inspection may also include a review of Owner-Operator's pertinent records. Inspection, testing and / or approval by CBPU or the omission of any inspection, testing and/or approval by CBPU pursuant to this Agreement shall not relieve the Owner-Operator of any obligations or responsibility assumed under this Agreement.

The Owner-Operator is responsible for the periodic scheduled maintenance on those relays, interrupting devices, control schemes, and batteries that involve the protection of CBPU electric system. If the interconnection system is certified to meet IEEE Std. 1547.1, the Standard requires that testing be conducted in accordance with written test procedures, and the nationally recognized testing laboratory providing certification, will require that such test procedures be available before certification of the equipment. Otherwise, a periodic maintenance program is to be established to test these relays or inverters at least every 2 years. Test reports of such testing shall be maintained by the Customer-Generator and made available for CBPU inspection upon request for a period of four years.

Each routine maintenance check of the inverter equipment shall include both an exact calibration check and an actual trip of the circuit breaker or contactor from the device being tested. For each test, a report shall be submitted to CBPU indicating the results of the tests made and the "as found" and "as left" relay calibration values. Visually setting, without verification, of a setting is not considered an adequate relay calibration check.

- 10 Site Limitations:** The Owner-Operator is responsible for evaluating the consequences of unstable generator operation or voltage transients on the

Generating Facility equipment, and determining, designing, and applying any relaying which may be necessary to protect that equipment. This type of protection is typically applied on individual generators to protect the Generating Facility.

CBPU will determine if operation of the Generating Facility will create objectionable voltage flicker and/or disturbances to other CBPU customers and develop any required mitigation measures at the Owner-Operator's expense. If at any time during operation of the Generating Facility, an objectionable voltage flicker and/or disturbances to other CBPU customers are determined, CBPU will develop any required mitigation measures at the Owner-Operator's expense. At the sole discretion of the CBPU, the Owner-Operator will be required to shutdown operation of the Generating Facility until satisfactory mitigation measures have been implemented.

- 11 Revenue Metering Requirements:** CBPU will own, operate, and maintain all required metering equipment. Two meters will be required.

Special billing metering will be required.

The Owner-Operator shall provide CBPU access to the premises at all times to install, turn on, disconnect, inspect, test, read, repair, or remove the metering equipment. The Owner-Operator may, at its option, have a representative witness this work.

The metering installations shall be constructed in accordance with the practices, which normally apply to the construction of metering installations for residential, commercial, or industrial customers. For Generating Facilities with multiple generators, metering of each generator may be required. When practical, multiple generators may be metered at a common point provided the metered quantity represents only the gross generator output.

CBPU shall supply to the Owner-Operator all required metering equipment and the standard detailed specifications and requirements relating to the location, construction, and access of the metering installation and will provide consultation pertaining to the meter installation as required. CBPU will endeavor to coordinate the delivery of these materials with the Customer-Generator's installation schedule during normal scheduled business hours.

The Owner-Operator may be required to provide a mounting surface for the metering equipment. The mounting surface and location must meet the CBPU's specifications and requirements.

The responsibility for installation of the equipment is shared between the CBPU and the Owner-Operator. The Owner-Operator may be required to install some of the metering equipment on its side of the PCC, including instrument transformers, cabinets, conduits, and mounting surfaces. CBPU shall install the meters and communication links. CBPU will endeavor to coordinate the installation of these items with the Owner-Operator's schedule during normal scheduled business hours.

- 12 Automatic Reclosing:** CBPU employs automatic multiple-shot reclosing on most of the CBPU's circuit breakers and circuit reclosers to increase the reliability of service to its customers. Automatic single-phase and three phase overhead reclosers may be installed on distribution circuits to isolate faulted segments of these circuits.

The Owner-Operator is advised to consider the effects of Automatic Reclosing (both single-phase and three- phase) to assure that the Generating Facility's internal equipment will not be damaged. In addition to the risk of damage to the Generating Facility, an out-of-phase reclosing operation may also present a hazard to CBPU's electric system equipment since this equipment may not be rated or built to withstand this type of reclosing.

Should CBPU determine relaying and control equipment that needs to be installed to protect its own equipment from out-of-phase reclosing. Installation of this protection will be undertaken by CBPU at the Owner-Operator's expense.

- 13 Other:** The Owner-Operator shall follow all current Solar Net Billing Generator Interconnection Policy provisions and as may be changed by the CBPU. The Owner-Operator shall also follow any future requirements required by CBPU in order for CBPU to meet electric system operating requirements and requirements of any regulatory agency, market participant or agent of the CBPU, including but not limited to the Midwest Independent System Operator, North American Reliability Corporation, and Reliability *First* Corporation.

**APPENDIX E
CONTACT LIST**

